


TYPICAL DETAIL AT CULVERT ENDWALLS

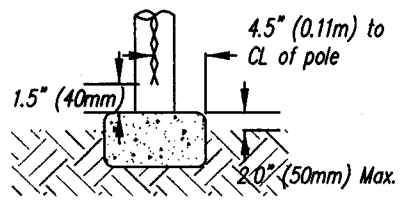

SECTION A-A

| FENCING TABLE | |
|------------------------------|---|
| HEIGHT 1 | |
| H | 6' (1.8 m) |
| DC | 3'-0" (.9 m) |
| DL | 2'-6" (.76 m) |
| TERMINAL POST OR CENTER POST | 2-7/8" O.D. GALV. PIPE (7.3 cm) 5.79 #/ FT. (8.8 kg/m) |
| LINE POST | H COLUMN 2-1/4" x 1-7/8" (5.7 x 1.9 cm) 4.10 #/ FT. (8.1 kg/m) 2-3/8" O.D. GALV. PIPE (6 cm) 3.85 #/ FT. (5.4 kg/m) |
| FENCE FABRIC | 9 GAUGE, 2 INCH (5 cm) MESH, GALV. AFTER WEAVING, KNUCKLED TOP AND BOTTOM |
| REDWOOD SLATS | 2-3/16" x 1/4" (3 x .635 cm) |

NOTES:

1. Installation of fencing and gates shall be in accordance with the requirements of Section 80-4 of the "Standard Specifications, State of California, Department of Transportation", approved current edition.
2. A 9.0" thick x 12" wide (0.22m x 0.3m) concrete curb shall be constructed under all fences, a 1.5" (40mm) clearance between the curb and fabric shall be used.
3. See standard D-13 for concrete notes.
4. Corner posts shall be installed at all angles in fence line in excess of 10'.
5. End, corner, and gate posts shall be braced to the nearest line post with galvanized diagonal or horizontal braces used as compression members and galvanized 0.375" (10mm) steel truss rods with turnbuckles or truss tightener used as tension members.
6. Fabric shall be fastened to gate post, terminal post, or corner post with 0.25" x 0.75" (5mm x 20mm) stretcher bar bonds at 8.0" (0.2m) on center.
7. Fabric shall be fastened to line post, last runner, and bottom tension wires with fabric bonds spaced approx. 14" (0.36m) apart.
8. Fabric shall conform to ASTM A-392, Class 1.
9. Subgrade preparation shall be constructed true to grade and cross section with compaction of 90% to a depth of 0.5' (0.15m).

FILENAME: D-12REV

| | |
|---|-------------------------|
| <p>STANDARD CHAIN-LINK FENCE</p> | DATE 6/2/99 |
| | DRAWN GLR |
| <p>CITY OF BAKERSFIELD CALIFORNIA</p> | CHECKED M. SHAW |
| | SCALE N.T.S. |
| APPROVED | SHEET NO. D-12 |
| CITY ENGINEER | PUBLIC WORKS DEPARTMENT |