


DETAILS FOR LENGTHS IN EXCESS OF 6 m (20')

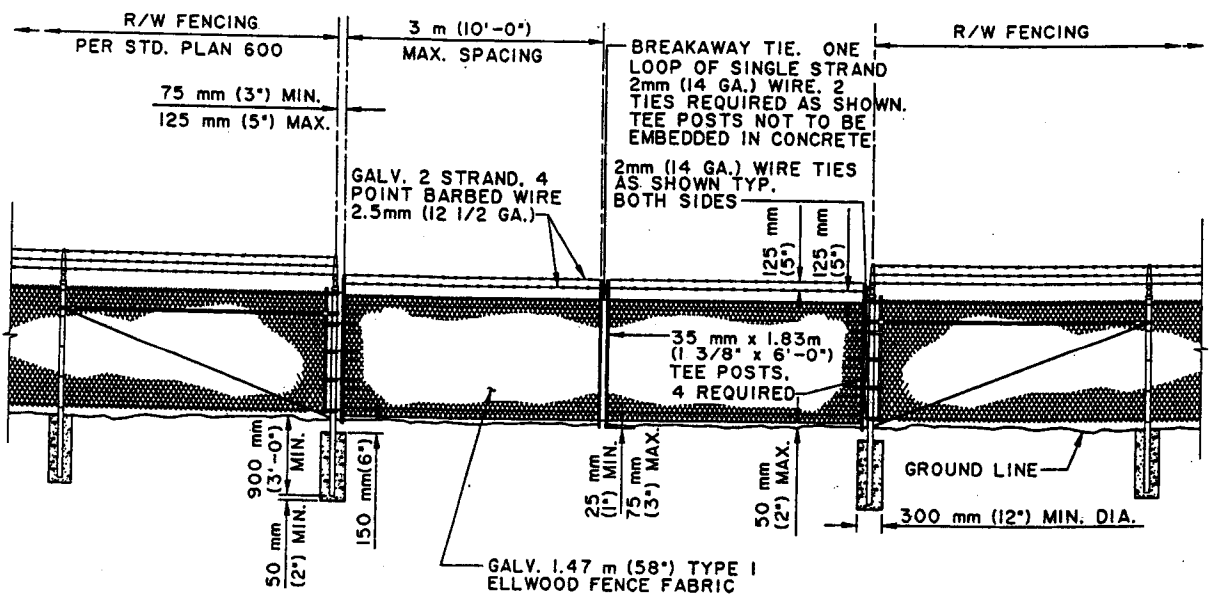

DETAILS FOR LENGTHS OF 6 m (20') OR LESS

LOS ANGELES COUNTY DEPARTMENT OF PUBLIC WORKS

BREAKAWAY FENCING

STANDARD PLAN
METRIC

APPROVED

Thomas A. Edmanson
DIRECTOR OF PUBLIC WORKS

5/31/1992
DATE

1999

REVISIONS

6001-1

SHEET 1 OF 2

NOTES

1. ALL FENCE MATERIALS AND FITTINGS SHALL CONFORM TO "STANDARD SPECIFICATIONS" UNLESS OTHERWISE SPECIFIED.
2. THE FABRIC SHALL BE PLACED ON THE DOWNSTREAM SIDE OF THE POSTS, STRETCHED TAUT, AND FASTENED AS SHOWN.
3. POSTS SHALL BE 35 mm x 35 mm x 3 mm (1 3/8" x 1 3/8" x 1/8") MINIMUM, GALVANIZED TEE FENCE POSTS.
4. TEE POSTS NOT TO BE EMBEDDED IN CONCRETE. TEE POSTS SHALL BE DRIVEN 900 mm (3'-0") INTO GROUND AT 6 m (20'-0") OC. OTHER INTERMEDIATE TEE POSTS SHALL BE SET AS SHOWN.
5. DIMENSIONS SHOWN ON THIS PLAN FOR METRIC AND ENGLISH UNITS ARE NOT EXACT EQUAL VALUES. IF METRIC VALUES ARE USED, ALL VALUES USED FOR CONSTRUCTION SHALL BE METRIC VALUES. IF ENGLISH UNITS ARE USED, ALL VALUES USED FOR CONSTRUCTION SHALL BE ENGLISH UNITS.

LOS ANGELES COUNTY DEPARTMENT OF PUBLIC WORKS

BREAKAWAY FENCING

STANDARD PLAN
METRIC

6001-1

SHEET 2 OF 2